
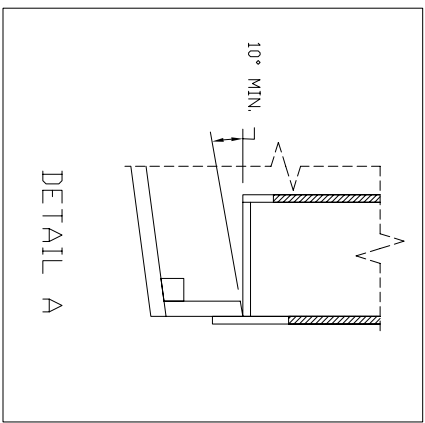


LAST REV.	DATE	DESCRIPTION

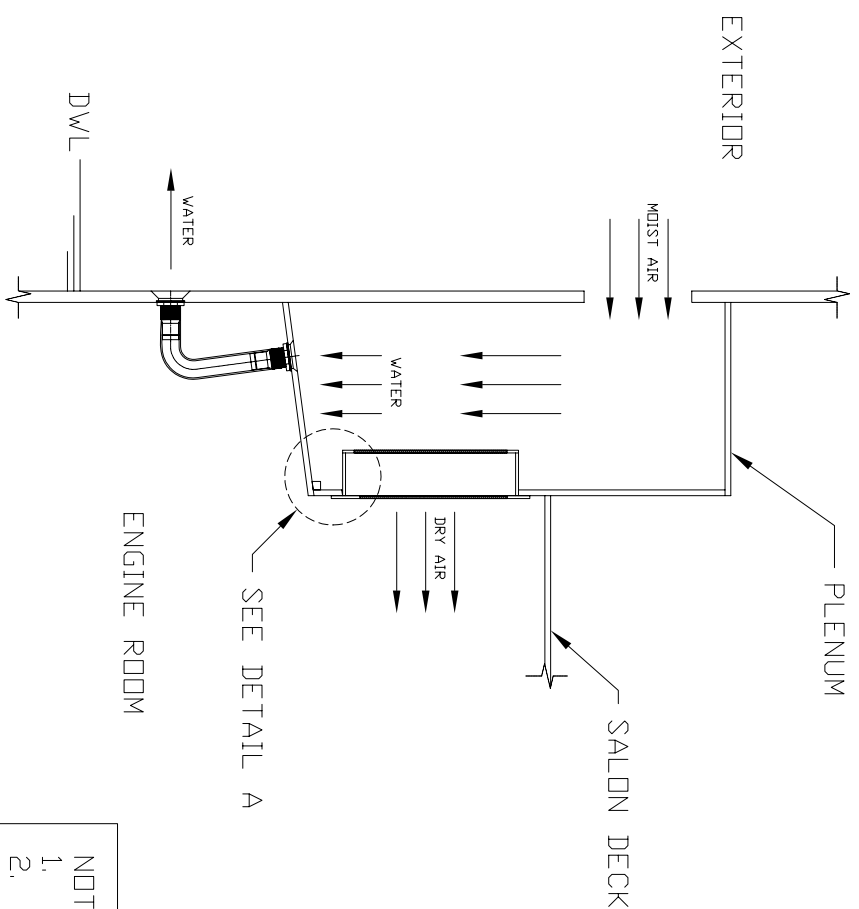

- NOTES:
1. PLENUM DRAIN SHOULD BE MIN. 2" ID HOSE
 2. MOUNTING FLANGES MUST BE SEALED WITH CAULK OR SEALANT CONTINUOUSLY W/D VOIDS
 3. PLENUM FREE DEPTH SHOULD BE EQUAL OR GREATER TO NET OPENING HEIGHT OF MIST ELIMINATOR UNIT
 4. LOWER EDGE OF PLENUM CUT OUT SHOULD BE BEVELED 10 DEGREES MINIMUM TO AVOID POOLING OF DRAINED WATER <SEE DETAIL A>
 5. ALL PLENUM BOX PENETRATIONS MUST BE SEALED TO AVOID MOISTURE BY-PASS OF THE MIST ELIMINATOR

TITLE:

CUSTOMER NAME:

Livos Technologies, LLC.

OUTSIDE BOTTOM DRAIN MIST ELIMINATOR

LIVOS TECHNOLOGIES, LLC.

SCALE: NA

ORDER #: XXX-XX-XXX

SERIAL #: XXX-XXXX

DATE: 12-14-2006

TOTAL QUANTITY 1 PAGE 1 OF 1 PAGES

DWG #:

3201 SE RAILROAD AVE.
STUART, FL 34997 U.S.A.
TEL. 772-220-1524 FAX. 772-220-1524